

Description

Compact and rugged, the DR82 Infrared Refrigerant Leak Detector helps you find leaks fast in the field. The 10 year infrared (IR) sensor detects all HFC, HCFC, CFC, HFO, and blends.

Multiple indicators and sensitivity 20x higher than soap bubbles make it easy to track down even the smallest leaks in various environments. A red LED flashes at the tip so you can keep your eyes on the target. The large bars on the backlit LCD are easy to see in bright sunlight or low light, and the numerical value provides an extra digit of resolution.

Unlike conventional leak detectors, you have full control with both an automatic (AZERO) and manual (MZERO) zero mode.

The large Li-ion rechargable battery provides over 10 hours of continuous operation and is convenient to charge via USB-C. Replaceable tips filter out water and dust while getting into tight spots. All wrapped up in a ruggedized IP54 housing, it's built for the field.

What's Included

DR82 Infrared Refrigerant Leak Detector Blow Molded Carrying Case (ABM2) AC Charger and USB-C Cable (RCA3) 5 x Filter Tips and Gaskets (RFT6)

Operator's Manual 1 Year Limited Warranty

Specifications

Sensor Type: Infrared (IR) Sensor Life: 10 years typical

Sensitivity Levels: High, medium, low, turbo (selectable) **Maximum Sensitivity:**

0.03 oz/yr (1g/a), stationary; 0.1 oz/yr (3g/a), in motion **Detection Feedback:**

Red tip LED, LCD bar graph, LCD digits, beeper Refrigerants: HFC, HCFC, CFC, HFOs, and blends

Response Time: <1 seconds typical **Recovery Time:** <5 seconds typical

Battery Type: 3.7 VDC (nominal) 2550mAh, non-replaceable **Charge Time:** 6 hours typical with included charger. Battery Life: 10 hours typical, backlight off

Auto Power Off: 10 minutes without detection or button press Operating Environment:

 32° F to 104° F (0° C to 40° C); < 75% RH (non-condensing) **Storage Temperature:** $-4^{\circ}F$ to $140^{\circ}F$ ($-20^{\circ}C$ to $60^{\circ}C$); < 80% RH

Weight: 14 oz (400g) Water Resistance: Designed to IP54 **US Patent:** www.fieldpiece.com/patents

Certifications and Compliance



Regulatory Compliance Mark



Waste Electrical and Electronic Equipment

UK CA UK Conformity Assessed

EN 14624

Restriction of Hazardous

Substances Compliant

WARNINGS

Inhalation of high concentrations of refrigerant vapor can block oxygen to the brain causing injury or death.

Do not use this device in a combustible gas atmosphere or with A3 refrigerants such as R-290, propane or R-600, isobutane. Do not block exhaust port or device or will not function properly.

Quick Start

- 1. Move to a refrigerant-free environment and hold 少 until your DR82 powers on.
- 2. Allow warm-up (calibration) to complete.
- 3. Begin searching for the leak source. Move the tip slowly (~3 inches/sec) and as closely as possible to the suspected refrigerant line.
- 4. Search until refrigerant gas is detected. Red light flashes, audible alarm triggers, and the display indicates the relative gas concentration.
- 5. Confirm leak source.


Move tip away from alarm location for a few seconds to clear the sensor. Return tip back to suspected leak, looking for the highest value.

Maintenance

CLEANING: Clean the exterior with a damp cloth. Do not use detergents or solvents.

BATTERY CHARGING: Recharge the internal battery as needed using the USB-C cable. In addition to the AC plug, most generic USB ports supply enough power to charge. The long life Liion rechargable battery is permanently installed. To maximize battery life, minimize time spent at


FILTER REPLACEMENT: The hydrophobic filter is built into the replaceable tip and should be replaced periodically to maximize sensor life and performance. Five filtered tips (RFT6) are included. Unscrew the tip to remove.

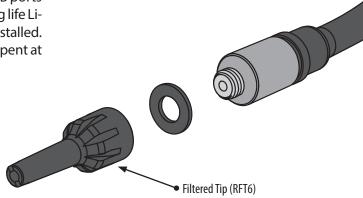

Functionality Test

Use a refrigerant tank and a cap to check if your DR82 is detecting refrigerant properly.


1. Tightly cap a refrigerant tank port to seal it.



2. Open valve to coat the inside of the cap, then close the valve.



3. With DR82 set to high sensitivity (H), remove the cap and wave the tip over the cap. You should see a very large leak size of approximately "99" and a full bar graph. If not, the filtered tip may need to be replaced.



100% full or 0% full.

Operation

Power

Press ψ >1 second to toggle power.

Backlight

Press 🖖 to toggle the blue backlight.

Zero Modes (AZERO/MZERO)


DR82 starts up in automatic zero mode (AZERO) which sets a new zero point every 4-5 seconds, indicated by a double beep.

Moving closer to the leak source will show the relative increase in concentration, triggering the alarm. Conversely, stopping at or moving away from the leak source will not trigger a response.

Press MANUAL/AUTO >1 second to toggle manual zero mode (MZERO). DR82 does not zero automatically while MZERO is displayed and will continue to alarm and display the relative leak size.

Zero Set

In manual zero mode (MZERO), press **ZERO** to initiate a 10 second calibration, during which "Zeroing" is displayed. For best performance, remain stationary until calibration finishes.

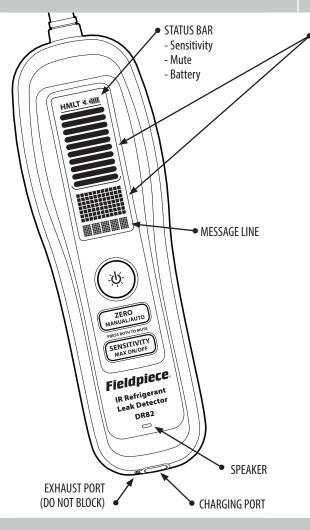

Numerical Leak Size Indicator with Bar Graph

The number is the relative concentration of refrigerant gas (0-99 units). The bar graph shows the same measurement in steps of 10 units for easy monitoring. The higher the number, the higher the concentration of gas being measured and the closer you are to the exact leak location.

Maximum Mode

Press MAX ON/OFF >1 second to toggle max mode. When max mode is on, the highest leak size detected is continually recorded.

The recorded max is cleared when the sensitivity is changed or if manually zeroed.

Sensitivity (H/M/L/T)

DR82 starts up in high sensitivity (H) which is recommended for most situations. When leaks are difficult to pinpoint due to excess triggering or sensor saturation, press **SENSITIVITY** to cycle to another sensitivity (Medium/Low/Turbo). Turbo is extremely sensitive, and may false trigger from abrupt motion or small changes in gas content.

Mute (≼\)

Press **ZERO** and **SENSITIVITY** simultaneously to toggle the speaker.

Red Leak Indicator LED

In most situations, the red LED at the tip is easier to monitor than the display. Because the blink rate increases as the relative concentration increases, many leaks can be found without ever viewing the display.



Limited Warranty

This leak detector is warranted against defects in material and workmanship for one year from date of purchase from an authorized Fieldpiece dealer. Fieldpiece will replace or repair the defective unit, at its option, subject to verification of the defect.

This warranty does not apply to defects resulting from abuse, neglect, accident, unauthorized repair, alteration, or unreasonable use of the instrument.

Any implied warranties arising from the sale of a Fieldpiece product, including but not limited to implied warranties of merchantability and fitness for a particular purpose, are limited to the above. Fieldpiece shall not be liable for loss of use of the instrument or other incidental or consequential damages, expenses, or economic loss, or for any claim of such damage, expenses, or economic loss.

Local and national laws may vary. The above limitations or exclusions may not apply to you.

Obtaining Service

Visit **www.fieldpiece.com/rma** for the latest information on how to obtain service in the U.S. and Canada.

For customers outside the U.S., warranty for products should be handled through local distributors.

Visit **www.fieldpiece-europe.com/store-locator** for local distributors in Europe.

© Fieldpiece Instruments, Inc 2025; v06

Safety First!

For use only by qualified and certified technicians in the safe use, handling, and transporting of refrigerants. Please refer to flammable refrigerant safety guides, regional codes and legislation for more information.

MARNINGS – failure to heed these hazards and actions can result in serious injury or death

- 1. Always use a grounded outlet
- 2. Always wear Proper Protective Equipment (PPE), which includes gloves and safety glasses
- 3. Know proper safety and handling requirements of the refrigerant in the Safety Data Sheet (SDS)
- 4. Avoid breathing refrigerant and oil vapors
- Handle hoses and equipment carefully as refrigerant is under high pressure and can cause frost bite
- 6. Do not operate in or near explosive atmospheres
- Perform leak detection in accordance with recommended practice to verify working environment is free from leaking refrigerant as it can be toxic and or flammable
- Only work in well-ventilated areas (minimum of 4 air exchanges per hour)
- Ensure power and extension cords are in good working condition to prevent shock and spark hazards

Additional safety instructions for recovering A2L refrigerants (e.g. R-32, R-1234yf, R-1234ze):


 Adhere to local occupational safety codes and possess detailed knowledge and skills when handling mildly flammable refrigerants

- 2. Have emergency, evacuation, and fire protection plans
- 3. Designate and monitor a Temporary Flammable Zone with a 3-meter perimeter
- Identify and disable all possible ignition sources within this Zone
 Monitor air with a flammable refrigerant leak detector within
- Monitor air with a flammable refrigerant leak detector within this Zone
- 6. Use a ventilation fan to maintain 5 air exchanges per hour within this Zone
- Make power connection of the recovery machine and other equipment outside of the Temporary Hazard Zone
- 8. Bond the recovery machine outlet port to the recovery tank's unpainted fitting with a grounding strap to dissipate static electricity buildup during recovery process
- 9. Ensure area around machine is free of debris that could enter air vents and fan and cause accidental sparking
- 10. Always remain in attendance and observant when the machine is running
- 11. Do not mix flammable refrigerants with air
- 12. Use an evacuated DOT recovery tank
- 13. If system has a suspected leak, stop recovery at 0 psig/bar to prevent air from entering the recovery tank
- 14. After recovery, purge system with 100% nitrogen before opening system for repair


⚠ CAUTIONS – failure to heed these conditions can cause equipment damage.

- 1. Ensure that recovery machine, hoses, tank and other equipment are in good working condition
- 2. Avoid overfilling recovery tanks by following refrigerant manufacturer's filling instructions and using a weight scale
- . Avoid cross contamination by not mixing refrigerants

More HVACR Products from Fieldpiece



Vacuum Pumps

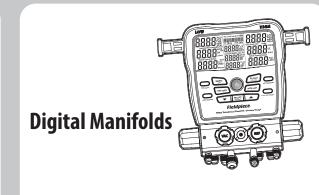



Job Link® System Clamp Meters



Job Link® System Probes



Refrigerant Recovery Machines